




1. Select **Batch re-save** from the File drop-down menu within KONTAKT's Main Control Panel:



2. A warning dialog appears. Click Yes to proceed:




3. Locate the Library folder in the OS X Finder or Windows Explorer. In this example, we are selecting **The EIII OMI MSC V1 Library**. Once selected, click **Choose** to proceed:

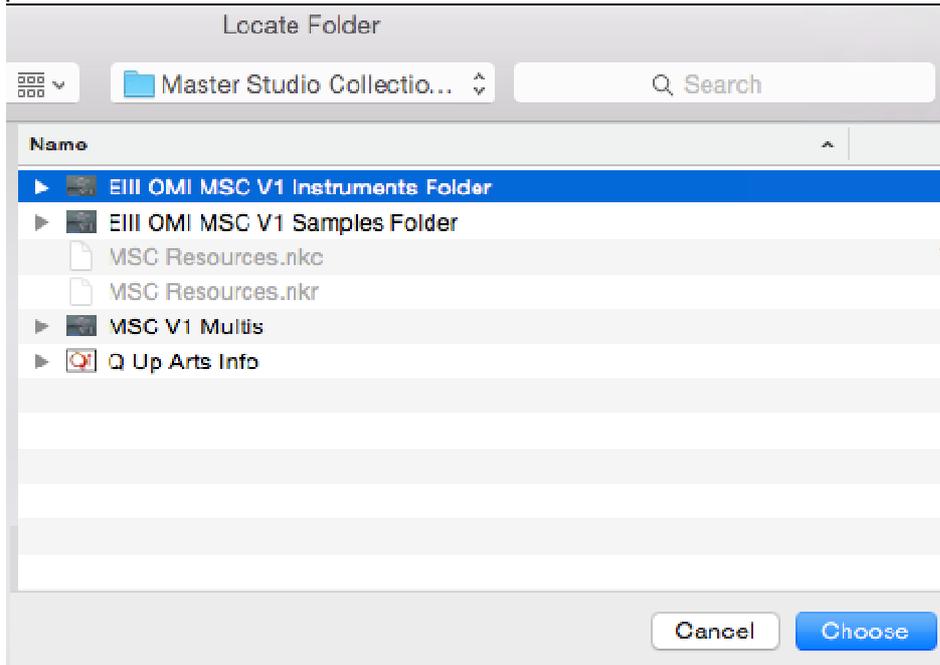

4. At this point, KONTAKT will check the Library. If wallpaper pics, .nkr's or other resource files are missing select "Browse for files". If samples are missing, a **Samples Missing** dialog will appear. In this dialog appears, click **Browse for folder**:



5. In the **Locate Folder** window which now appears, select your Library's **Samples** folder. Once selected, click **Choose** to proceed:

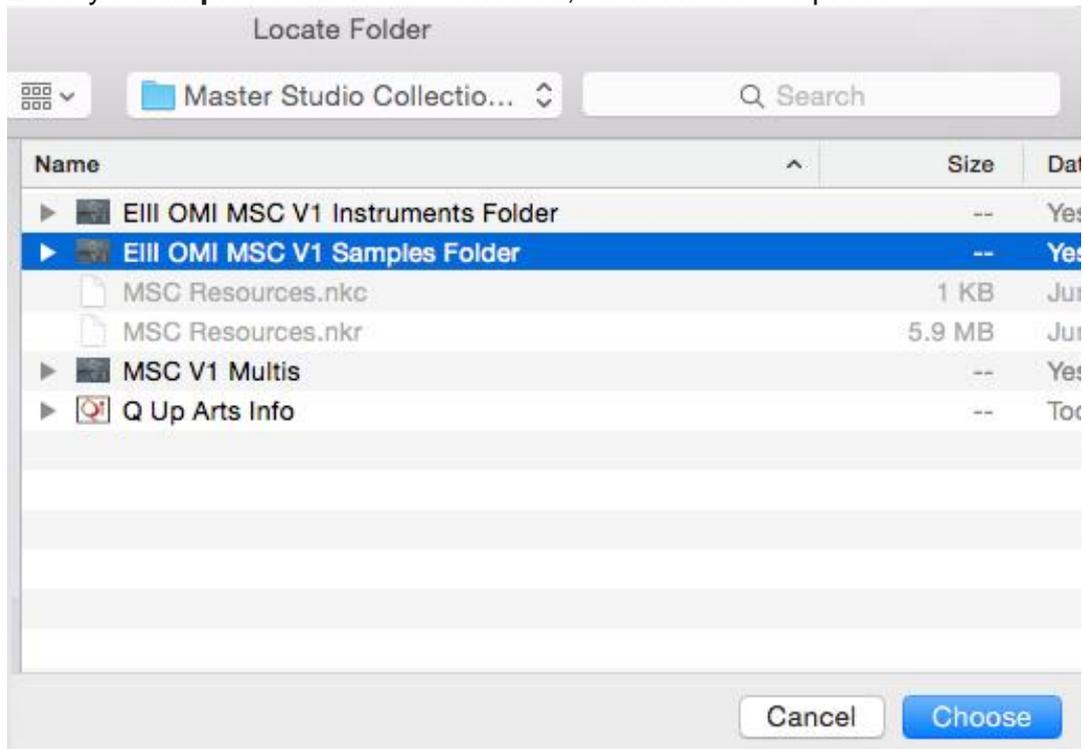

KONTAKT will now batch re-save the Library and re-link all the Library's Instruments to their respective sample content. Your KONTAKT Library's Instruments will now load correctly!